



ET-05 / ET-08GES

INSTALLATION GUIDE - 8mm GEL END SEAL CAP


NOTE:

The end seal is designed to be installed only once; it cannot be removed from the heating cable once installed. Do not use until ready for final installation.

GEL END SEAL CAP 8mm for HTM/REM


STEP 1:

- 1) Cleanly cut off the end of the cable.
- 2) Score down and around outer jacket 1 1/4 inch from t end.
- 3) Remove the outer jacket.
- 4) Do not cut or damage inner jacket.

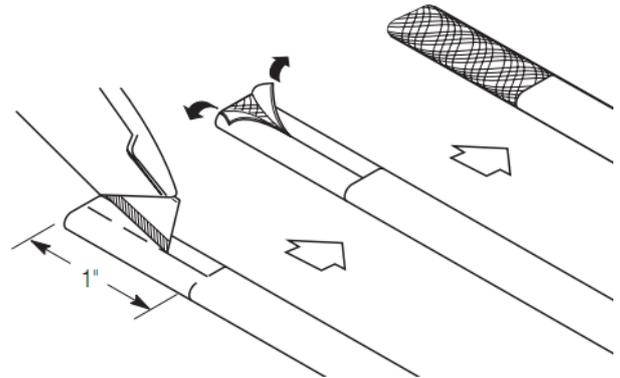


STEP 2:

Unravel and remove exposed braid.

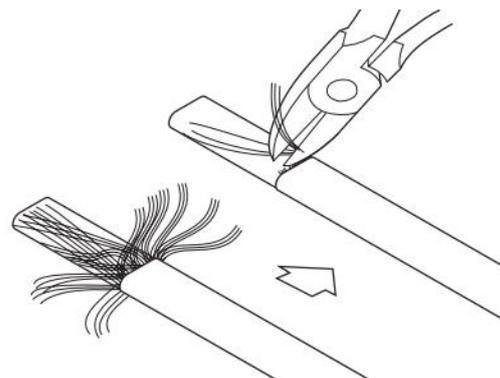

STEP 3:


- 1) Firmly push end seal onto the cable (at least 3/4 inches). Some gel may ooze out.
- 2) Do not twist or try to remove the end seal during or after insertion. Do not reuse an end seal.

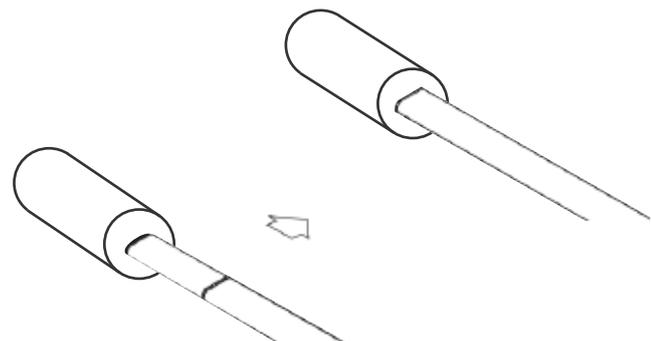

GEL END SEAL CAP 8mm for HTM/REM


STEP 1:

Cleanly cut off the end of the cable.

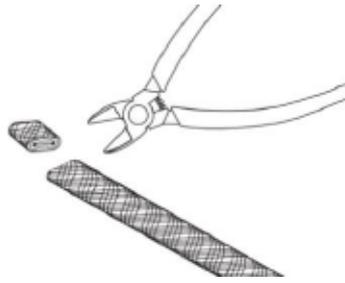


STEP 2:

Push the braid back 2 inches from the cable end.

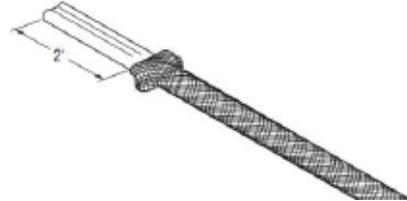

STEP 3:

- 1) Firmly push end seal onto the cable (at least 3/4 inches). Some gel may ooze out.
- 2) Do not twist or try to remove the end seal during or after insertion. Do not reuse an end seal.

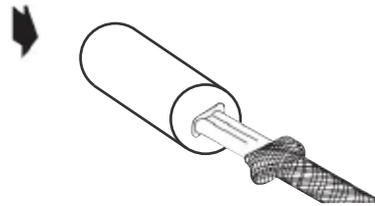

STEP 4:

Slide the braid up against the end seal and secure with the 6-inch length of tape provided.

